

GATE VALVE TYPE ZS160 ; ZK160

CHARACTERISTIC:

Diameter	-	50 -500 mm;
Pressure	-	160 bar;
Temperature	-	up to 670°C;
Medium	-	water, steam and other non-toxic, non-aggressive media

VERSIONS:

type / body material / drive type / others


Example: ZS160 / -- / --- / ---

Example: ZS160 / U / NA / ---

Body material	Sign	Drive type	Sign	Others	Sign
(P250GH) C 22.8	---	Hand wheel	---	-----	---
16Mo3	U	AUMA drive	NA		
13CrMo4-5	A	NWA drive	NW		
11CrMo9-10	B	MODACT drive	NM		
14MoV6-3	C				
X10CrMoVNb9-1	E	Pneumatic drive	NP		

APPLICATION:

Gate valve is designed to open and stop the flow. The gate valve can be mounted to a pipeline in any position. It should operate in a close or open position.

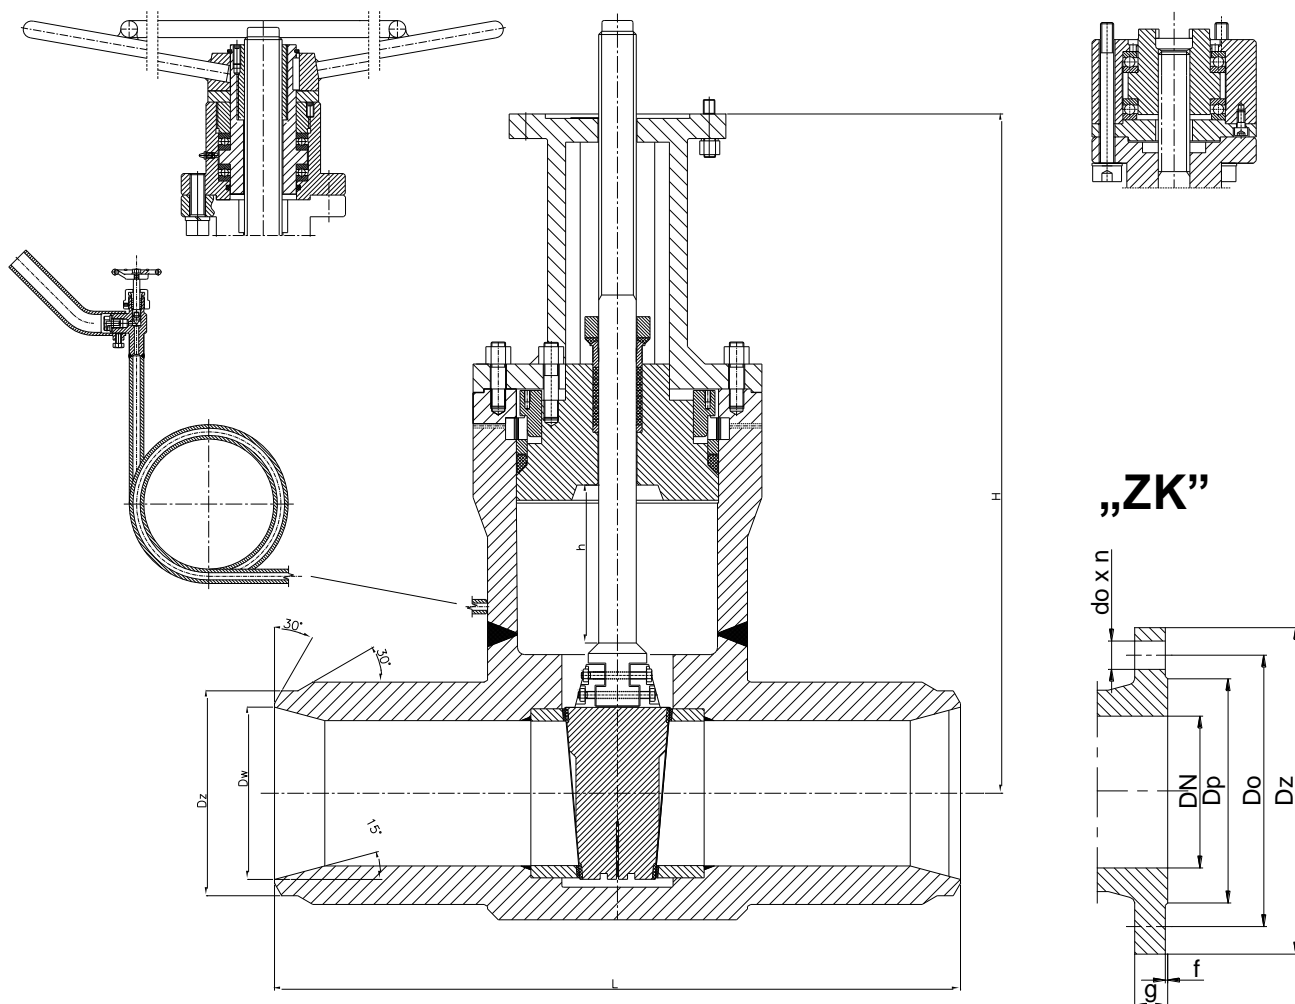

WK

® FABRYKA ARMATURY PRZEMYSŁOWEJ

„WAKMET” spółka jawna

Kaczmarek, Krzywdziński, Wachowski, Wilczyński

Bodzanów 75 48-340 GŁUCHOŁĄZY 1

tel. +48(077) 439-40-20, fax +48(077) 439-18-72

e-mail: wakmet@wakmet.com.pl

http: www.wakmet.com.pl

MATERIALS:

Versions	Standard	U	A	B	C	E
Parts	T _{MAX} 450°C	T _{MAX} 530°C	T _{MAX} 560°C	T _{MAX} 600°C	T _{MAX} 570°C	T _{MAX} 670°C
Body, bonnet, wedge	(P250GH) C22.8 (1.0460)	16Mo3 (1.5415)	13CrMo4-5 (1.7335)	11CrMo9-10 (1.7383)	14MoV6-3 (1.7715)	X10CrMoVNb9-1 (1.4903)
Stem	X39CrMo17-1 (1.4122)					
Seat ring	Stellit					
Wedge ring	Stellit					
Packing rings	Grafit					
Wheel	Steel					

Special materials on request; modifications reserved.

DIMENSIONS:

DN	Dz	Dw	L	H	h	Dk	Weight	"ZK"								
								Dz	Dp	Do	do	n	L	g.	f	Weight
50	62	52,5	300	490	61	400	37,80	195	102	145	30	4	300	30	3	51,80
65	77	65	360	534	77	400	58,50	220	122	170	26	8	360	34	3	78,50
80	91	76,5	390	613	92	500	103,50	230	138	180	26	8	390	36	3	127,50
100	117	98,5	450	690	115	700	144,00	265	162	210	30	8	450	40	3	179,00
125	144	120,5	525	760	140	700	207,00	315	188	250	33	8	525	44	3	261,10
150	172	144,5	600	970	160	850	244,80	355	218	290	33	12	600	50	3	355,80
175	by customers acceptance							by customers acceptance								
200	223	189	750	1240	225	1100	566,10	430	285	360	36	12	750	60	3	703,10
250	278	242,5	900	1450	270	1100	930,60	515	345	430	42	12	900	68	3	1152,6
300	329	285,5	1050	1300*	335	-	1522,80	585	410	500	42	16	1050	78	4	1852,80
350	by customers acceptance							by customers acceptance								
400	by customers acceptance							by customers acceptance								
450	by customers acceptance							by customers acceptance								
500	by customers acceptance							by customers acceptance								

Dimensions in mm; modifications reserved.

TECHNICAL DATA:

Body material	PN	Maximal working pressure at working temperature																
		20°C	100°C	150°C	200°C	250°C	300°C	350°C	400°C	450°C	480°C	500°C	520°C	530°C	540°C	560°C	570°C	600°C
		bar																
(P250GH)C 22.8 (1.0460)	160	160,00	148,50	140,90	133,30	121,90	110,40	102,80	95,20	52,50	-	-	-	-	-	-	-	-
16Mo3 (1.5415)	160	160,00	160,00	160,00	160,00	156,10	137,10	129,50	121,90	118,00	89,70	70,80	44,90	35,80	-	-	-	-
13CrMo4-5 (1.7335)	160	160,00	160,00	160,00	160,00	160,00	159,20	152,30	144,70	137,10	117,40	104,30	71,60	59,40	46,40	30,40	25,10	-
14MoV6-3 (1.7715)	160	160,00	160,00	160,00	160,00	160,00	160,00	160,00	159,20	154,70	153,50	147,00	113,50	99,80	86,10	65,50	55,60	-
11CrMo9-10 (1.7383)	160	160,00	160,00	160,00	160,00	160,00	160,00	156,10	148,50	140,90	118,00	102,80	78,40	68,50	59,40	44,10	38,80	25,9

MOUNTING AND OPERATING:

The gate can only be mounted and operated by skilled, properly trained and qualified personnel. Incorrect assembly or operation of the gate may have substantial impact on the entire system such as fluid leakage, reduction in system's function etc.

Before a gate is installed the pipeline must be clean from any mechanical impurities. The compatibility of critical parameters of the flow must be checked with the parameters of the gate. Gate can be mounted to a pipe-line in any position. The direction of the flow should only comply with the arrow marked on the body. The valve should be operated strictly with its assign. In order to provide gate's reliability the following suggestions must be observed:

- medium flowing through the gate is supposed to be clean out of any mechanical impurities;
- the valve must be protected from any mechanical damages during its work;
- nominal parameters marked on the valve must be observed.